

HR70-14

~~TOP SECRET~~

NPIC/R-838/64

October 1964

TCS-7863/64

Copy 100

6 Pages

PHOTOGRAPHIC INTERPRETATION REPORT

UZHGOROD ARMY BARRACKS SOUTHEAST UZHGOROD, USSR CARPATHIAN MD

APPROVED FOR RELEASE -
HISTORICAL COLLECTION
DIVISION - HR70-14
DATE: 05-10-2012



CIA




DIA

Handle Via **TALENT - KEYHOLE** Control Only

WARNING

This document contains classified information affecting the national security of the United States within the meaning of the espionage laws U. S. Code Title 18, Sections 793 and 794. The law prohibits its transmission or the revelation of its contents in any manner to an unauthorized person, as well as its use in any manner prejudicial to the safety or interest of the United States or for the benefit of any foreign government to the detriment of the United States. It is to be seen only by personnel especially indoctrinated and authorized to receive TALENT-KEYHOLE information. Its security must be maintained in accordance with KEYHOLE and TALENT regulations.

NATIONAL PHOTOGRAPHIC INTERPRETATION CENTER

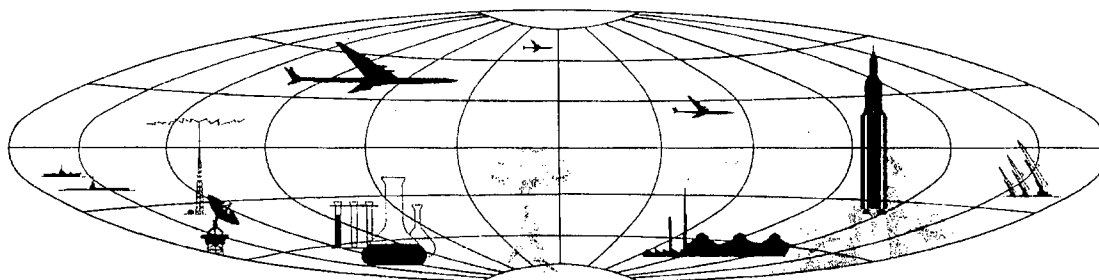

~~TOP SECRET~~

GROUP 1
Excluded from automatic
downgrading and declassification

~~TOP SECRET RUFF~~

Handle Via
TALENT-KEYHOLE
Control System Only

TCS-7863/64
NPIC/R-838/64

PREFACE

This report is one in a series on Soviet Ground Force and Logistic installations being prepared for a DIA/CIA Panel. The series is being coordinated, published and disseminated by NPIC. The photographic analysis is being performed by the NPIC Photographic Analysis Group, the CIA Photographic Intelligence Division (NPIC), and the Production Center 1P1c (DIA). The photographic analysis for this particular report was performed by the Production Center 1P1c.

In the interest of uniformity, the titles and letter designators for the facilities observed at these installations are identical with those appearing in the project requirement. When a specific facility is not observed both its title and letter designator are omitted in the report.

Titles and letter designators for the various facilities are as follows: (A) railroad service, (B) road service, (C) landing strips, (D) administrative and troop housing areas, (E) storage areas, (F) ammunition storage areas, (G) POL storage areas, (H) other buildings and facilities, (J) equipment storage/maintenance areas, (K) athletic fields, (L) small arms firing ranges, (M) driver training areas, (N) tank/assault gun firing ranges, (P) flat trajectory firing ranges, (Q) artillery emplacements (batteries), (R) infantry or combined arms field training areas or courses, (S) special training facilities, (T) unidentified facilities or tracking activity.

- 1 -

~~TOP SECRET RUFF~~

Handle Via
TALENT-KEYHOLE
Control System Only

UZHGOROD ARMY BARRACKS SOUTHEAST

(48-36N 022-18E)

UZHGOROD, ZAKARPATSKAYA OBLAST, USSR

CARPATHIAN MD

BE No: AL No: 2 COMOR No:

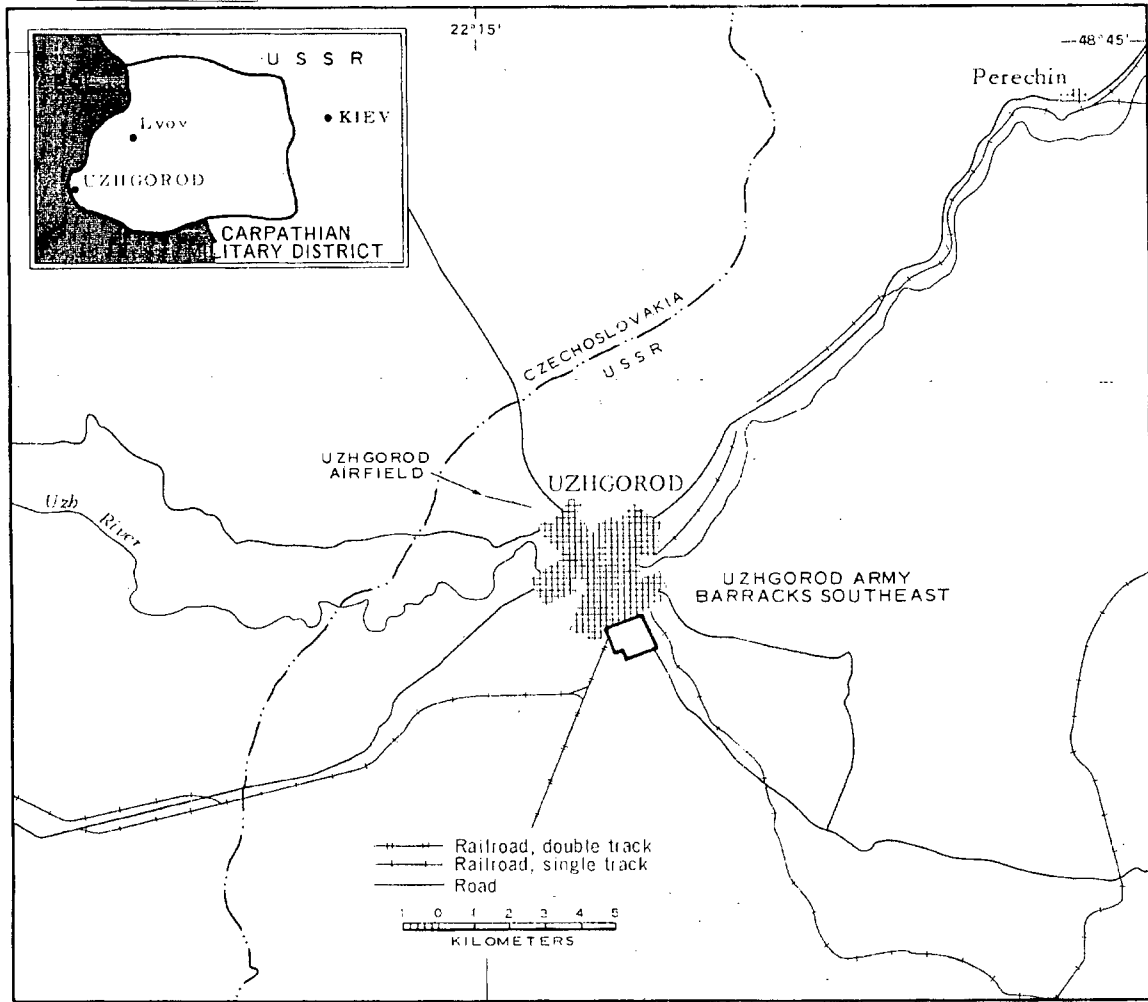


FIGURE 1. LOCATION OF UZHGOROD ARMY BARRACKS SOUTHEAST.

NPIC J-3811 (9/64)

SUMMARY

A medium-sized military installation is located on the southeast outskirts of Uzhgorod along the southwest side of the road to Mukachevo. The installation was covered by [redacted] between August 1961 and September 1963. The reference [redacted] report indicates that the installation has undergone con-

siderable expansion since World War II.

The installation (Figures 2 and 3) contains troop barracks, warehouses, vehicle maintenance and storage buildings, POL and ammunition storage, and a small arms firing range. It reportedly houses AAA, tank, and motorized rifle troops.

DESCRIPTION OF INSTALLATION

Railroad Service

The area is bisected by the Chop-Perechin rail line. Two to three tracks serve two track-side docks and one rail-end loading dock. The warehouse area is rail served.

Road Service

The area is situated on an all-weather, hard-surface road.

Administrative and Troop Housing Areas

Area D1 contains 20 single story 150- by 35-foot barracks, two permanent 150- by 50-foot multistory headquarters buildings, and six 50- by 25-foot barracks.

Area D2 contains fourteen 100- by 50-foot barracks.

General Storage Area

Area E contains 16 permanent 150- by 50-foot buildings in a warehouse area, one 50- by 50-foot warehouse with a loading platform, and three 300- by 50-foot warehouses.

Ammunition Storage Areas

Area F1 contains nine 20- by 20-foot partially bunkered ammunition storage buildings,

Area F2 contains four 100- by 20-foot ammunition storage buildings and two 20- by 20-foot partially bunkered ammunition storage buildings, and Area F3 contains two 20- by 20-foot ammunition storage buildings.

POL Storage Area

Area G contains three 20- by 10-foot miscellaneous storage buildings, pumping facilities, and 10 circular tanks, eight 25 feet in diameter and two 50 feet in diameter.

Equipment Storage/Maintenance Area

Area J contains two motor parks, one 1,000 by 1,000 feet and one 1,500 by 1,000 feet, a 2,500- by 1,500-foot equipment park, three 100- by 50-foot administration buildings, 11 vehicle storage sheds, six 150 by 50 feet and five 350 by 100 feet, five 100- by 35-foot vehicle maintenance buildings, five vehicle maintenance shops, three 350 by 100 feet and two 300 by 75 feet, and eight 100- by 50-foot vehicle storage sheds.

Small Arms Firing Range

Area L is a 325- by 100-foot small arms firing range with two range buildings.

~~TOP SECRET RUFF~~

Handle Via
TALENT-KEYHOLE
Control System Only

TCS-7863/64
NPIC/R-838/64

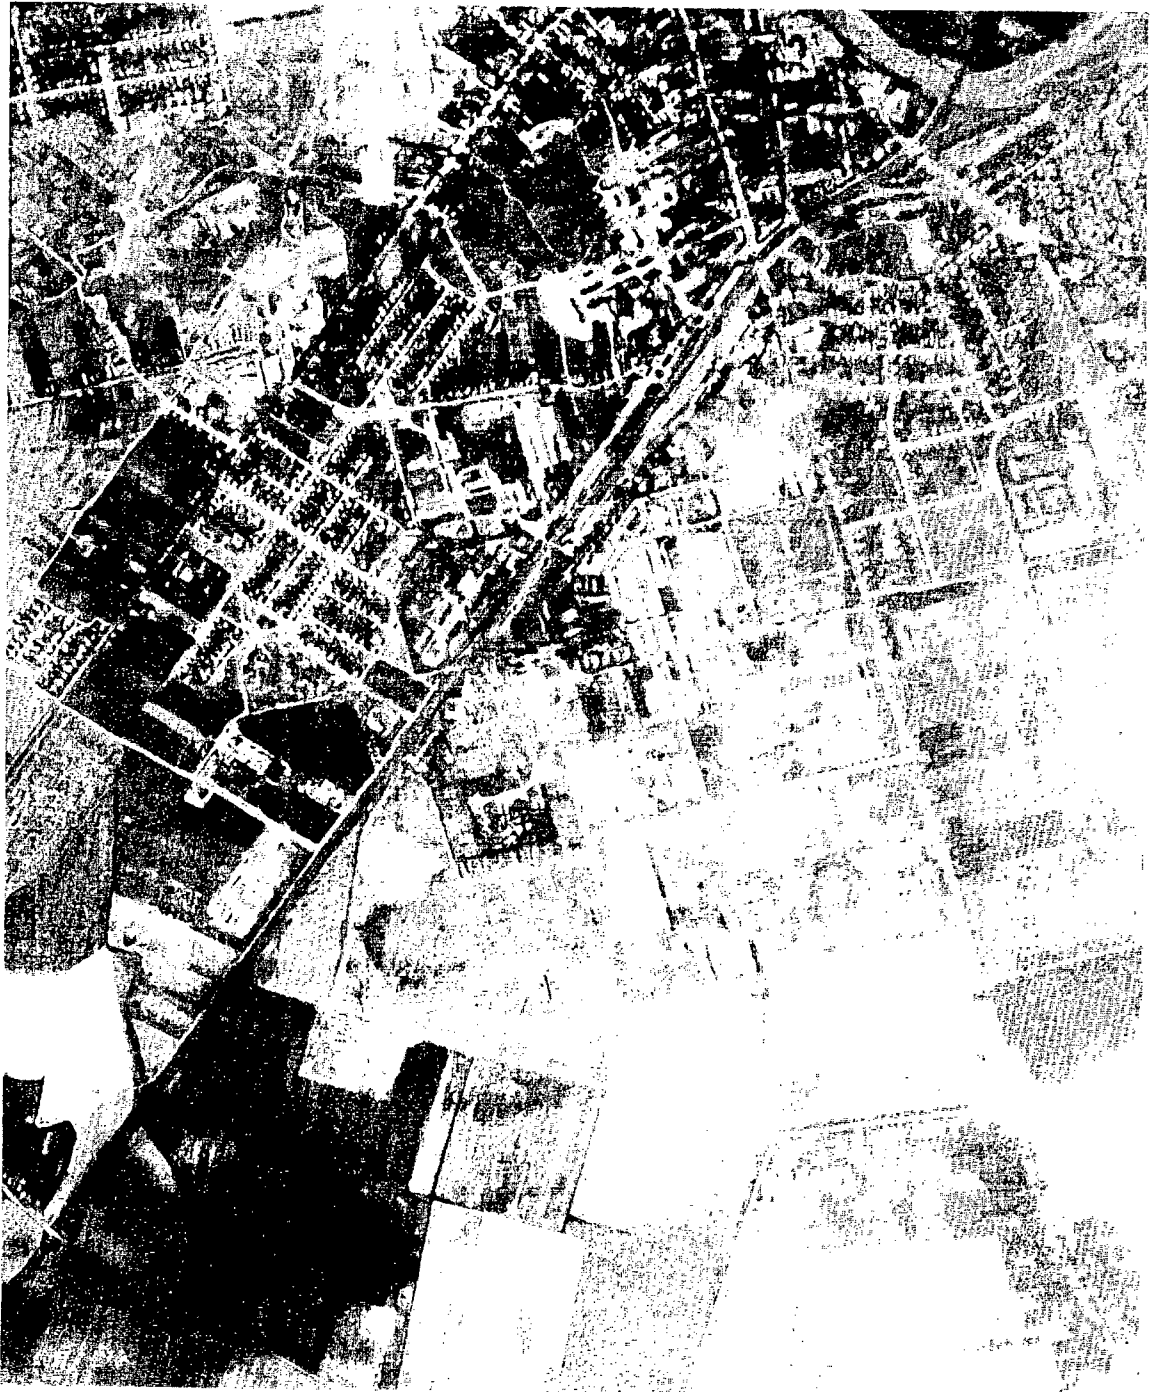


FIGURE 2. UZHGOROD ARMY BARRACKS SOUTHEAST, USSR, JUNE 1963.

NPIC J-3812 (6/64)

- 4 -

~~TOP SECRET RUFF~~

Handle Via
TALENT-KEYHOLE
Control System Only

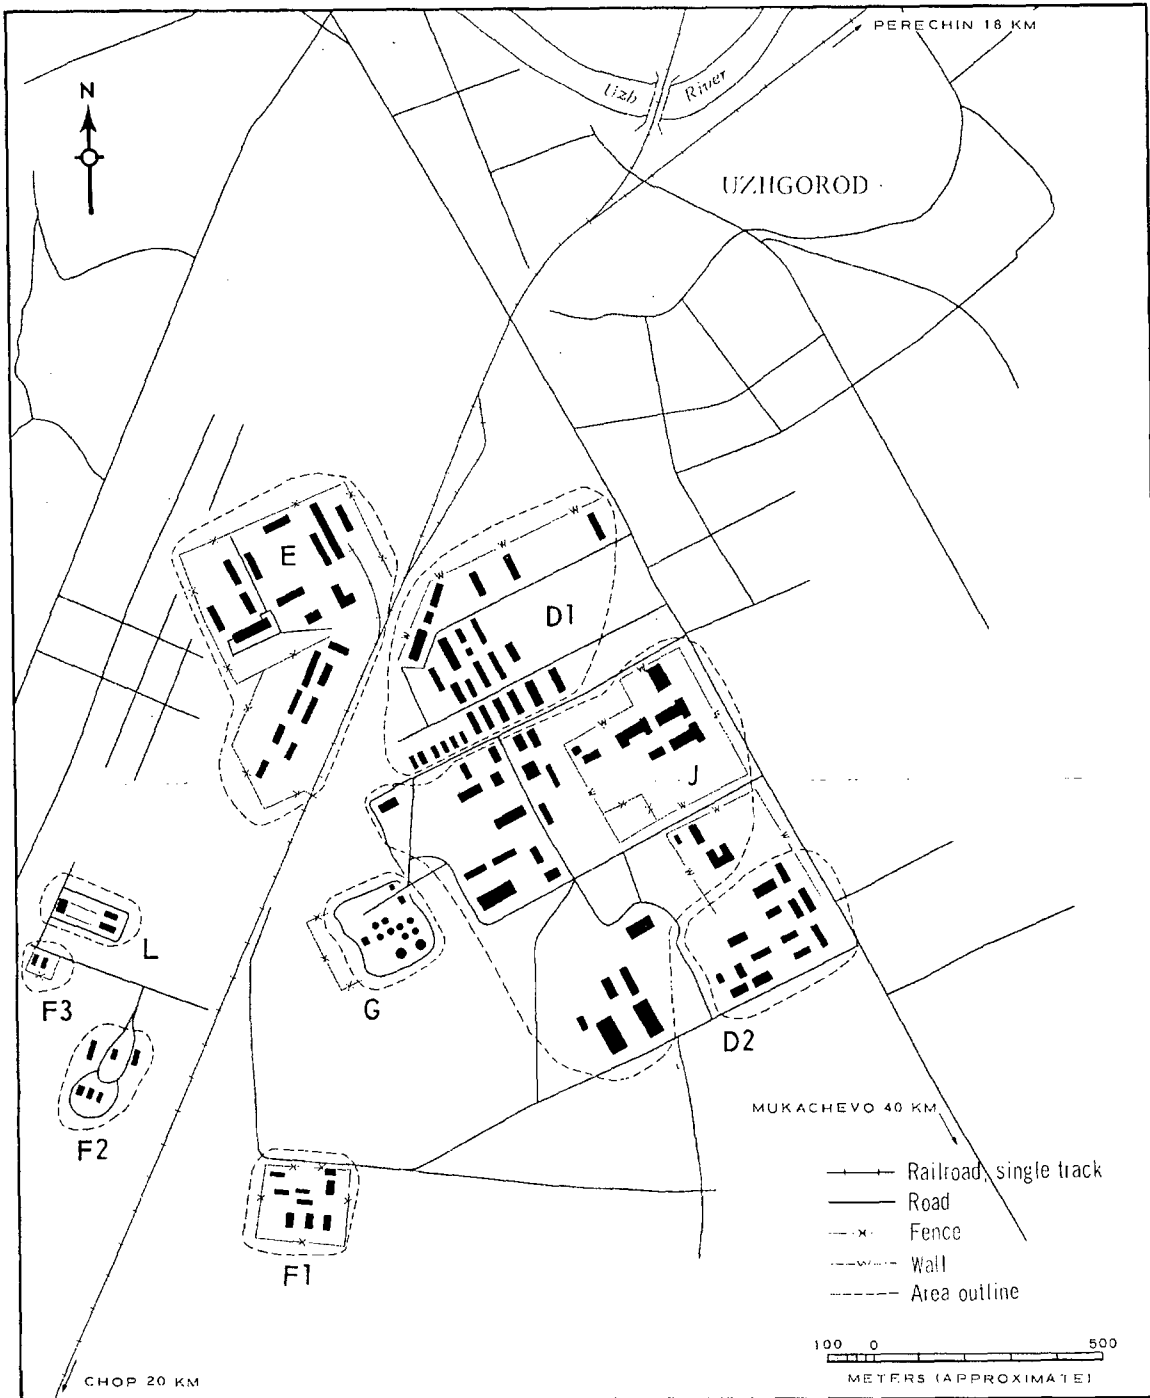


FIGURE 3. UZHGOROD ARMY BARRACKS SOUTHEAST. Sketch compiled from [redacted] September 1963.

Handle Via
TALENT-KEYHOLE
Control System Only

TCS-7863/64
NPIC/R-838/64

REFERENCES

PHOTOGRAPHY

<u>Mission</u>	<u>Date</u>	<u>Pass</u>	<u>Camera & Frame</u>	<u>Classification</u>
[Redacted]				TOP SECRET RUFF
				TOP SECRET RUFF
				TOP SECRET RUFF
				TOP SECRET RUFF
				TOP SECRET RUFF
				TOP SECRET RUFF

MAPS OR CHARTS

US Air Target Chart, Series 200, Sheet 0232-24HL, 2d ed, Aug 63 (SECRET)

DOCUMENTS

[Redacted]

REQUIREMENT

DIAAP-1-15-64 (partial answer)

NPIC PROJECT

S-650.64

Handle Via
TALENT-KEYHOLE
Control System Only

~~TOP SECRET~~

~~TOP SECRET~~